



**RAPPORTO DI PROVA  
(test report)**

**N° 0101**

**29/08/2011**

**RISULTATI SPERIMENTALI**

**Elemento in prova: POLIPIOMBO BUGNATO**

Area del campione

S = 1,30m<sup>2</sup>


Volume della camera ricevente

V = 52m<sup>3</sup>

Volume della camera emittente

190m<sup>3</sup>

FREQ. Hz	R dB
100	16,2
125	11,6
160	16,0
200	16,0
250	17,3
315	18,2
400	20,1
500	21,4
630	22,7
800	25,5
1000	27,9
1250	30,7
1600	34,6
2000	36,9
2500	39,0
3150	36,0
4000	32,7
5000	28,8

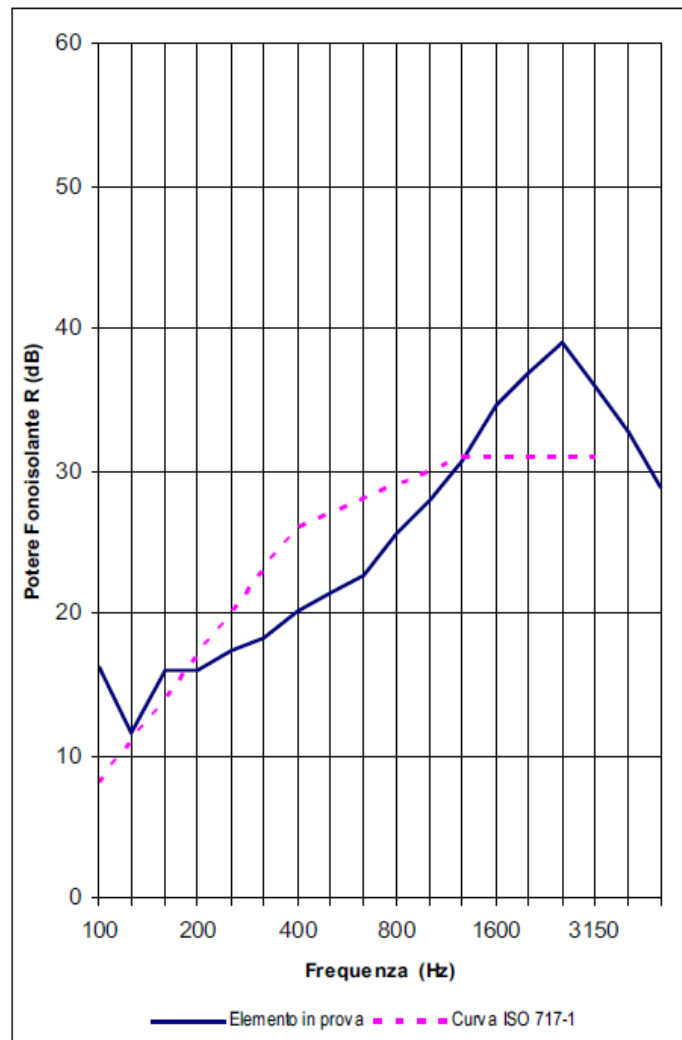

**R<sub>w</sub> (C; C<sub>tr</sub>) = 27 (-1 ; -4) dB**

Valutazione secondo ISO 717-1 (nella banda 100 ÷ 3150 Hz) basata su misurazioni ottenute in laboratorio